Demystifying the P-F Curve & Augmenting Machine Learning for Maintenance Optimization

Gary Josebeck, President & CEO, RAMwright Consulting Company, LLC

Arun Gowtham, Reliability Engineer, Sanofi Pasteur

SUMMARY & CONCLUSIONS

P-F Curves are ubiquitous in the maintenance departments of industries, where it is used to explain the concept of an asset exhibiting symptoms of a failure before it experiences failure. This prognostication has been labeled as the effective way to plan maintenance programs. Though it is correct, the relentless push for its use using non-destructive prognostics tools has changed its meaning and interpretation by many end-users. Few curves are being drawn with 'vibration analysis' marked only in the region after a potential failure giving a misleading guide that this tool can be applied only after a failure has started. We are rescripting this by highlighting the fundamentals of the P-F Curve, as originally formulated, to train the readers for its use in everyday maintenance operations. The first half of the paper goes into detail on the foundations of the P-F Curve, the terms, and its definitions. It also briefs on how to choose the setup of these curves for an application. Following the steps described here will enable maintenance personnel to generate a P-F Curve and use the insight to plan maintenance work.

The second half of the paper combines the fundamentals of the curves with Machine Learning techniques. This union of ideas is the natural extension of the way to push the boundaries of maintenance optimization. We describe how to supplement the traditional P-F Curve with Machine Learning by using the asset's performance data; to garner information in real time; to estimate its behavior; to use as feedback to improve the setup. This causes the curve to evolve into a dynamic plot and enhance the detection of failure by utilizing multiple parameters instead of a univariate. Finally, the pitfalls of using this new technology to support the P-F Curves is briefly discussed to serve as a caution to the user.

1 INTRODUCTON

The P-F Curve may be one of the most covered topics in the Reliability Engineering field. Since its proposal it has been adapted by the maintenance teams in various industries and has evolved into an over-arching idea to incorporate many unrelated Maintenance and Reliability concepts, thereby complicating its applicability for everyday use. Recommendations from the Reliability-Centered Maintenance framework includes Inspection tasks on assets to prompt a maintenance action but the misinterpretation of the P-F Curve results in mistiming the inspection or the tool used, or the parameter documented. The rest of this paper simplifies the current heavily burdened P-F Curve by revisiting the fundamentals and proposes a framework for enhancing the curve by using Machine Learning to create a dynamic curve that is continuously updated based on the current dataset.

2 P-F CURVE DEMYSTIFIED

The P-F Curve traces an item's degradation, based on predetermined parameters such as vibration or temperature, from a condition of high "resistance to failure" to one of low "resistance to failure" (Y axis) over the item's operating time or cycles or age (X axis). See Figure 1.

As the term "resistance to failure" implies, an item moving along the curve, over time, becomes less and less able to resist failure until it ultimately fails to perform its function to the degree specified.

The two main points on the P-F Curve are the "P" and "F" points, where the P stands for Potential Failure, and the F stands for Functional Failure. A failure is simply described by Nowlan and Heap [1, 2] as "an unsatisfactory condition"; with a Functional Failure defined as "the inability of an item (or the equipment containing it) to meet a specified performance standard" and a Potential Failure is defined as "an identifiable physical condition which indicates a functional failure is imminent". We describe the physical condition at the Potential Failure point as the mechanism leading to the failure mode, example: abrasive wear (mechanism) ultimately leading to a seized bearing (failure mode).

A Potential Failure is often described today as "the point on the P-F Curve at which degradation begins" or "the point at which a defect can be detected" but this is a misunderstanding of Nowlan and Heap's work. While it is true that P is the point at which functional failure is

imminent, the "degradation"(i.e., failure mechanism) initiates earlier on the curve and may be evident (a small crack); but its condition is still within acceptable limits and therefore no corrective action is required. As a result of this misunderstanding, Point P is often believed to be "given" to us by a default condition such as "crack identified", when in practice Point P is chosen by the Reliability Engineer as the limit by which, if no corrective action is taken, the functional failure (F) is imminent within the timeframe estimated on the P-F Curve. The elapsed time from the Points P to F is called the P-F Interval (see Figure 1) and it is the "age" it takes for an item to deteriorate from the Potential Failure condition to Functional Failure. The dots represent points on the P-F Curve where events occur. These points occur within the zones of the curve as described
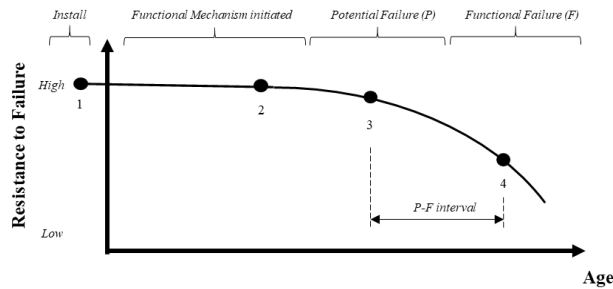

Figure 1: P-F Curve with P-F Interval.

2.1 Developing a P-F Curve Estimate

To develop a P-F Curve estimate we first need to establish an item's functions, then we can explore how the item fails to meet these performance expectations as functional failures. An example of a primary function for a pump is "to pump water at 100 gpm +0/-5 GPM at 100 PSI" and a secondary function is "to contain water without leaks". A Functional Failure then may be expressed as "cannot pump water greater than or equal to 95 GPM at 100 PSI" and another is "cannot pump water at all". The causes for these losses of functions are called Failure Modes. Of the many failure modes, one of them causing the secondary functional failure may be a "seized bearing".

The Reliability Engineer (RE) must understand the failure mode(s) to determine the identifiable physical mechanism(s) and the precise evidence (PMPE) by which the mechanisms are recognized, indicating that a functional failure is imminent. Figure 2 shows this relationship.

Once the identifiable physical mechanisms can be understood and recognized, the RE must choose a point on the curve to denote the Potential Failure limit. The optimal limit for P must be a point that will allow the maintenance department sufficient time to take corrective

action and restore resistance to the item prior to the functional failure, while also not correcting an item that still has substantial useful life.
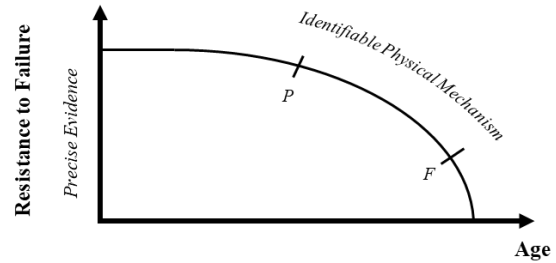

Figure 2: Physical Mechanism and Precise Evidence (PMPE)

Once the potential failure limit has been determined, the RE should select applicable and effective On-condition tasks to detect these conditions and take corrective action to prevent functional failure of the item when the conditional limits are exceeded.

In the case of "seized bearing", one mechanism leading to this failure mode is "abrasive wear" and can be precisely evidenced via Vibration (IPS, G's, Mils) and Ultrasonic Emissions (dB) among others. The RE should assign these On-condition tasks, or other applicable and effective inspections, to be collected using route-based techniques at a frequency of least ½ the P-F Interval to ensure that the potential failure condition is detected and that corrective actions can be properly planned and scheduled prior to functional failure.

Detecting the moment that our limit at Point P has been reached can be difficult when manually inspecting the conditions using hand-held route-based devices. It is very likely that the limit has already been exceeded by the time the inspection is performed or in worse cases Point P can be missed by as much as the duration of the inspection frequency, example: 30 days for a monthly inspection. The elapsed time between the point of detection of Point P and the Point F is called the Net P-F Interval. This is a more realistic view of how much time we have to plan and schedule a corrective action of the item when performing route-based inspections. If we wait too long to detect the degradation, we may not be able to act in time to prevent the functional failure. For this reason, we must ensure that our frequency of inspections is sufficient to allow the maintenance department to properly plan and schedule the corrective action. A best practice inspection frequency is one half the P-F Interval, example: if the P-F Interval equals eight weeks, then the inspection frequency should be 8 weeks / 2, or 4 weeks. If the inspection frequency is fixed, i.e., a vendor contract to come in at a specified frequency, then Point P will need to be adjusted higher on the P-F Curve

to accommodate the inspection frequency and still maintain a Net P-F Interval sufficient for maintenance to act.
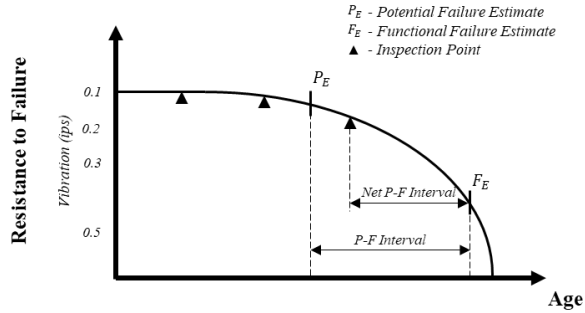

Figure 3: Net P-F Interval

2.2. P-F Curve Estimate Factors

As evident from Figure 3, inspection frequency is a crucial factor in designing a maintenance strategy from P-F Curve. The inspection interval influences the location of Point P on the curve. There are additional factors that also influence the location of Point P. They are *Asset Criticality, Spare Part Lead Time, and Decay Rate.*

For an asset that is highly critical in the operations, the RE will choose to set the Point P little earlier to allow for variations in maintenance execution. Similarly, if the Spare Part Lead Time changes, then the team must start the maintenance intervention at an appropriate point of potential failure detection to account for the availability of the spare part. The rate at which the asset's resistance to failure is decaying will have the significant effect on the limit of Point P as explained in the next section.

2.3 Decay rate: P_E vs P_F

An asset's exposure to stress does not always remain constant and may not stay within the designed levels. When a single stress or combined stresses reduce an item's resistance to failure sufficiently, a functional failure will occur sooner. These exposed stresses will reduce the useful life of an item considerably due to the accelerated rate of deterioration. With this increase in the rate of decay, the estimated P-F Interval may no longer apply, and corrective action will be required sooner than normally anticipated

For example, a bearing that is not installed correctly may pass commissioning requirements for initial vibration and temperature but endures accelerated rate of deterioration from the exposed stress [5]. In this scenario, by the time the estimated Point P (P_E) is reached, the forecasted remaining life may be reduced by 50 percent or more from the original estimates. Trending the actual rate of deterioration against historical estimates allows new data to plug into the equation. If Point P_E hasn't

been reached yet, but the rate of change has sufficiently increased, then P_E should be moved up to reflect the imminence of the Functional Failure. The new Point P is called Potential Failure Forecast (P_F) and reflects conditions on the ground. As P_F shifts higher and higher on the P-F Curve, the severity of the preventive maintenance action and its priority must be raised to ensure the work is scheduled and executed prior to Functional Failure. See Figure 4.
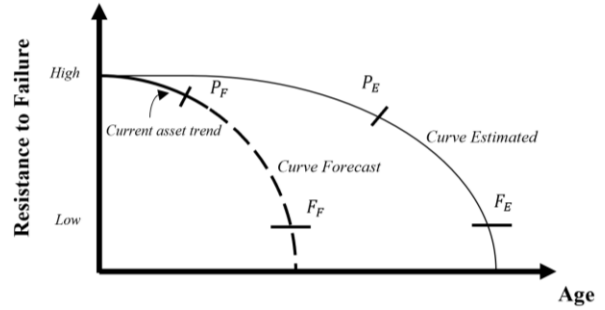

Figure 4: Forecasted P-F Curve due to Exposed Stresses

If the Decay Rate of the Estimated P-F Curve is (DR_E) and the Decay Rate of the current Forecasted P-F Curve is (DR_F), then the ratio of the rates can quickly identify the change in P-F interval.

$$Decay\ Rate\ Ratio = DR_E\ /\ DR_F \qquad (1)$$

If the Decay Rate Ratio >1, then the P-F interval is shrinking and if the Decay Rate Ratio <1, then the P-F interval is expanding. Due to inherent variability in the operation, two curves will always be different in comparison giving different decay rates. Two-sided limits shall be set on the Decay Rate Ratio to trigger a change in the definition of Potential Failure Point, only when its value is significantly out of the average.

An asset's exposure to varying stresses can also be incorporated into its P-F Curve through its S-N Curve (Stress-Life Curve). S-N Curve represents the relation between the accumulation of fatigue cycles and the asset life. Asset exposed to high amplitude stress for a short time and then operated at standard conditions should account for the lost age at the spike. This results in a modified P-F Interval and a modified location of Potential Failure Point to plan maintenance action. Modification of the curve set up should consider the maintenance action performed; a replacement of the asset will restore the P-F Curve whereas a repair will keep the new set up.

While the P-F Curve's use is beneficial, it is only an "estimate" of the future performance and remains static or unchanging throughout its use. Since the curve gets created and adopted for a failure mode based on a set of assumptions and operating conditions, there is no way to

update it based on the new operating conditions or stresses on the ground. If any of these conditions change from the historical trend, the P-F Curve and the strategies based upon it may no longer be valid and could lead to an unscheduled downtime event. A better approach is to use Machine Learning that supports real-time optimization of the curve.

3 USING MACHINE LEARNING TO SUPPLEMENT THE P-F CURVE MODELS

An efficient maintenance program is one which is continuously being optimized by using new performance data. Literature [6] in this research area outlines the need for organizations to prepare the collection of real-time data from assets and respond to it throughout its operating life. Continuously monitoring for new data throughout the asset life and re-plotting the P-F Curve will stretch the resources of any organization. Fortunately, there are affordable technologies available now that we could adapt to assist in continuous monitoring. Utilizing the infrastructure of the Industrial Internet of Things (IIoT), sensors can monitor the performance of critical assets and report back instantaneously. Since variability is inherent in all design, using point estimates from one asset to plot the P-F Curve for maintenance planning can be unreliable. Collecting numerous point estimates from a population of assets or from different usage conditions can help establish a baseline P-F Curve with a high confidence interval that will work in most conditions. Machine Learning (ML) tools should be applied at this stage to optimize the data and fit a curve. This can be validated as more data is used to train or when the Prediction decisions are verified.

The framework to apply Machine Learning for P-F Curves is given in Figure 5. The 'Parameters' for the model are the detectable-defining-characteristic of the failure mechanism (example: vibration g's for bearing failure, thickness for brake pad wear out). 'Inputs' are the data from the current operating conditions (current reading, time elapsed, average maintenance response time, repair cost). With these set up, a P-F Curve can be generated that establishes the Potential Failure point and the P-F Interval. Maintenance team should use this information in deciding the appropriate action on the asset. This framework is best executed when the outcome from it is used as feedback to improve its set up. The P-F interval predicted by the algorithm can be used to modify the 'Inputs'(F_b) in the form of changing the maintenance response time, work order priority, or data collection frequency. The accuracy of the prediction (Goodness-of-fit) can be evaluated to identify additional parameters (F_c) that are influencing the failure mechanism and can be added as 'Parameters' to monitor.

The outcome of the decisions made by the Maintenance Team can also be used to improve the setup of the P-F Curve (F_a) by validating the mechanism being observed and the 'Parameters' & 'Inputs' used.
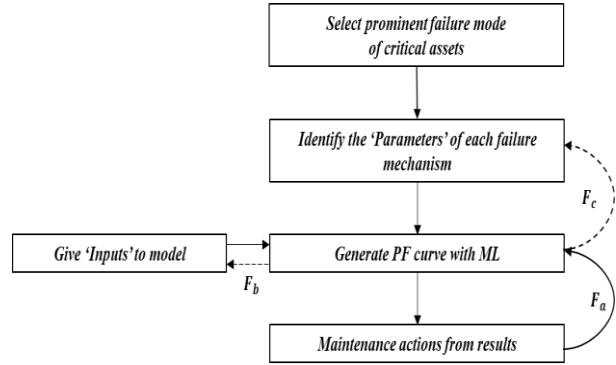

Figure 5: Framework to apply Machine Learning for P-F Curve plotting

Applying Machine Learning tools to generate P-F Curves negates the practical short-comings of the curve such as the curve not being up to date or the curve not fully capturing the failure mode behavior. We shall generate dynamic P-F Curves that change in real-time as the operating condition changes and shall also use multivariate regression analysis to capture the effects of all input parameters of a failure mode to model its performance degradation.

3.1 Dynamic P-F Curves

When the data being fed into the Regression Analysis is dynamic, the analysis provides dynamic model equations with the input 'Parameter' as its variable. When this input parameter changes unexpectedly- due to Operator Error or Increased load or External Stress – then the equation plots a different curve. This change can predict the new curve path and plot the new Failure state immediately. For example, in Figure 6: Curve A shows the predicted P-F Curve under normal operating conditions predicted from historical normal operation data. Curve B shows the P-F Curve for the same asset changing due to an increase in output demand. The P-F interval may also change due to its increased degradation and the P point changes correspondingly to give the maintenance team ample time to respond.

The change in stresses should be recorded quantitatively using additional data collection sensors pertinent to the failure mechanism chosen. Accumulation of fatigue is be calculated from this data as *Stress x Time* where 'Stress' is the amplitude and 'Time' is the time spent at this amplitude. With this data, a P-F Curve should be plotted at each fatigue levels for the same asset. Collecting dynamic curves of an asset over time will

enable the Reliability Engineer to record the range of behavior in all use cases.
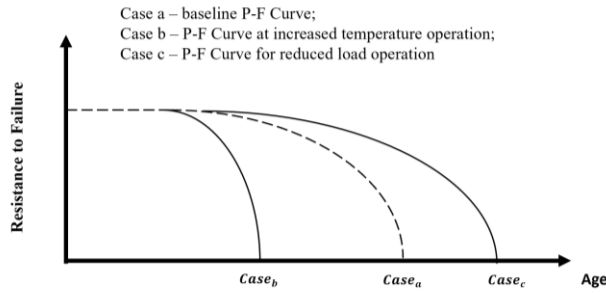

Figure 6: P-F Curves for the same asset can be Dynamic

3.2 Multivariate P-F Curves

If a critical asset has a failure mode, that is influenced by more than one 'Parameter' then a multivariate regression analysis [3, 4] can be used to plot the P-F Curve. The choice of parameters will depend on the failure mechanism and driven by the knowledge of the team. The team can use the literature to understand the physics of failure (PoF) or conduct own experiments (Reliability Testing) to determine the significant parameters affecting the failure mechanism. These parameters will be monitored continuously to feed into an algorithm and estimate the baseline degradation model with high confidence level. This method can be combined with the dynamic method described above to plot multivariate dynamic P-F Curves.
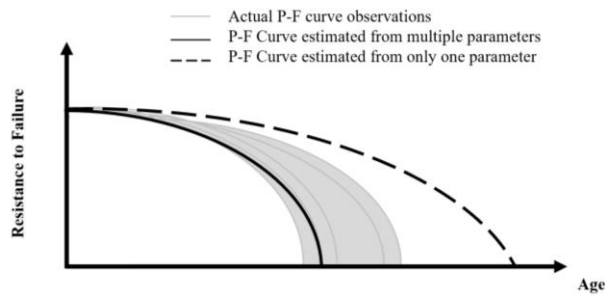

Figure 7: Using Multivariate Regression leads to better estimation of P-F Curve

While combining the methods of plotting a P-F Curve using Machine Learning, it is evident that the algorithm can give us insights on where the points of the P-F Curve are expected to be based on the current asset trend data.

This is represented in Figure 8 and uses a combination of extrapolation data and the historical trend of assets in the same population. This awareness will help the maintenance team in planning for the expected intervention; either for detection of imminent failure at "P" point or the observation of actual functional failure at "F" point.
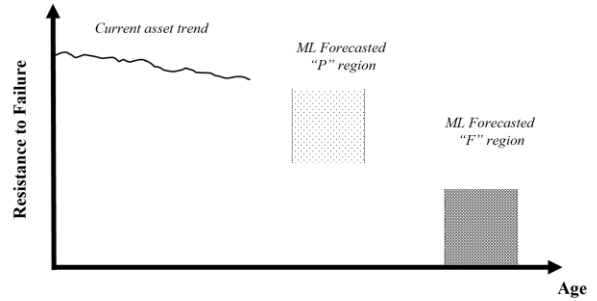

Figure 8: Machine Learning can forecast the region of P and F points of the P-F Curve

4 PITFALLS IN USING MACHINE LEARNING FOR P-F CURVES

General things to consider while developing a maintenance program with machine learning are:

Choice of asset, failure mode, and parameter: Use Criticality Analysis methods to determine the dominant failure mechanism of the critical asset and implement Machine Learning solution on it.

Data integrity: The data that is used to plot P-F Curve should have the attributes for machine learning. Corrupt or unlabeled data will lead to inaccuracy in the results.

Using the correct algorithm: The type of decision that the Maintenance team intends to make will determine the choice of the algorithm – regression, clustering, or classification.

Integrating with the Maintenance Program: Using Machine Learning tools as a standalone solution will not improve the effectiveness of the Maintenance program unless it is integrated with the workflow of the Maintenance Program. Any alerts generated by the dynamic P-F Curve must be notified and worked on by the Maintenance Team with priority determined by the estimated Net P-F interval and the current P Point.

5 FUTURE WORK

The authors intend to expand the work by implementing the concepts in this paper to a practical application and present the results with data. The field of Machine Learning is advancing at breakneck pace with new algorithms, capabilities, and features. The usability of these new tools for Reliability & Maintenance needs to be explored through practical solutions of installing the data collection infrastructure, training users on data analysis & interpretation. An industry wide guidance on the implementation & operation of Machine Learning

augmented Maintenance Program is within the scope of future work.

REFERENCES

1. F. S. Nowlan, et al, "Reliability-Centered Maintenance", United Airlines, 1978
2. John Moubray, 'Reliability- Centered Maintenance", 2nd Edition, The Aladon Network, 1997
3. W. Chen and G. Zhao, "A Multivariate Correlation Degradation Model for Reliability Analysis Based on Copula," 2020 Reliability and Maintainability Symposium (RAMS), 2020, pp.1-6
4. Li H, Li R, Li H, Yuan R. Reliability modeling of multiple performance based on degradation values distribution. Advances in Mechanical Engineering. October 2016.
5. J. Lee, H. Qiu, G. Yu, J. Lin, and Rexnord Technical Services (2007). IMS, University of Cincinnati. "Bearing Data Set", NASA Ames Prognostics Data Repository (http://ti.arc.nasa.gov/project/prognostic-data-repository), NASA Ames Research Center, Moffett Field, CA
6. A.K.S. Jardine, D. Lin, D. Banjevic, "A review on machinery diagnostics and prognostics implementing condition-based maintenance", Mechanical Systems and Signal Processing 20 (2006) 1483–1510

BIOGRAPHIES

Gary Josebeck
RAMWright Consulting Company,
Greensburg, PA 15601, USA

e-mail: gary.josebeck@ramwright.com

Gary Josebeck is the President and CEO of RAMwright Consulting Company, LLC. Gary started his career as a Machinist Mate in the U.S. Navy aboard the U.S.S. Enterprise CVN-65 and for over 32 years has been working in the Maintenance & Reliability field to improve asset availability, worker safety, and company's bottom line. Gary has patent applications for both wireless condition monitoring sensor technology as well as computer-based procedure software. Gary earned his bachelor's degree from Thomas Edison University in Nuclear Engineering Technology and is a Certified Reliability Engineer (CRE) from the American Society for Quality (ASQ).

Arun Gowtham
Reliability Engineer,
Sanofi Pasteur Limited
Toronto, ON M2R 3T4, Canada

e-mail: arun.gowtham@sanofi.com

Arun Gowtham is a Reliability Engineer coordinating the implementation of the Asset Management program at Sanofi's largest vaccine manufacturing facility. His interest is in employing data-driven analytics to underpin decision making for Reliability Management. Previous experience includes working on Hydrogen Fuel Cells and Chemicals production. He earned his master's degree in Mechanical Engineering from Drexel University, PA, USA and his bachelor's degree in Mechanical Engineering from Anna University, TN, India. Arun is Certified Reliability Engineer (CRE), an active volunteer in local reliability organizations, and is a registered engineer in Ontario.